


REVISIONS

NO. | DATE | REVISION | BY

1 | 12.09.19 | ISSUED FOR BP/TENDER | NM

LOCATION: 207										PANEL: D (Ex.)			MAINS: 225 AMPS, 120/208 V, 3ø, 4W					
LOAD DESCRIPTION	BRKR. SIZE	LOAD PER PHASE			CCT. NO.	PHASE			CCT. NO.	LOAD PER PHASE			BRKR. SIZE	LOAD DESCRIPTION				
		A	B	C		A	B	C		A	B	C						
RECEPTACLES ROOMS 214, 215	15A	1.2			1				2	--		15A	TP-1 RM 223					
RECEPTACLES ROOMS 214, 215	15A		1.2		3				4	--		15A	EF-101					
RECEPTACLES ROOMS 216, 217	15A			1.2	5				6	--		15A	EF-102					
RECEPTACLES ROOMS 216, 217	15A	1.2			7				8	--		40A	AC-101/CU-101					
RECEPTACLES ROOM 213	15A		1.2		9				10	--		2P						
RECEPTACLES ROOMS 212, 213	15A			1.2	11				12	--		1.6	20A	EMERGENCY LIGHTS				
GFCI RECEPTACLES ROOMS 210, 211, 221, 222	15A	1.2			13				14	1.6		20A	LIGHTS RMS 208-217					
RECEPTACLES ROOMS 212, 225	15A		1.2		15				16	1.6		20A	LIGHTS RM 225					
RECEPTACLES ROOM 225	15A			1.2	17				18		1.6	20A	LIGHTS RMS 218, 221, 222, 223					
RECEPTACLES ROOM 225	15A	1.2			19				20	--		15A	EXIT SIGNS					
RECEPTACLES ROOM 225	15A		1.2		21				22	1.2		15A	RECEPTACLES ROOM 207					
RECEPTACLES ROOMS 225, 206	15A			1.2	23				24	--	1.2	15A	RECEPTACLES ROOM 207					
RECEPTACLES ROOMS 206, 207, 208	15A	1.2			25				26	--		20A	COPIER ROOM 207					
RECEPTACLES ROOM 208	15A		1.2		27				28	--		15A	COPIER ROOM 207					
GFCI RECEPTACLES ROOMS 209, 223, 224	15A			1.2	29				30	--		15A						
DISHWASHER ROOM 209	20A	--			31				32	--		15A	RECEPTACLES ROOM 213					
MICROWAVE ROOM 209	20A		1.6		33				34	--		15A	RECEPTACLES ROOM 213					
REFRIGERATOR ROOM 209	20A			1.6	35				36	--		15A	RECEPTACLES ROOM 213					
REFRIGERATOR ROOM 224	15A	20A			37				38	--		15A	RECEPTACLES ROOM 213					
COUNTERTOP RECS ROOM 224	15A		1.2		39				40	--		15A						
	15A				41				42	--		15A						
SUB-TOTAL KW													SUB-TOTAL KW					
TOTAL PER PHASE (KW)										PHASE A = -- KW PHASE B = -- KW PHASE C = -- KW			-- KW CONNECTED					
SURFACE MOUNTED <input type="checkbox"/>										FLUSH MOUNTED <input type="checkbox"/>			COLUMN MOUNTED <input type="checkbox"/>			* DENOTES HANDLE LOCKING DEVICE		

LOCATION: 227										PANEL: E (New)			MAINS: 225 AMPS, 120/208 V, 3ø, 4W					
LOAD DESCRIPTION	BRKR. SIZE	LOAD PER PHASE			CCT. NO.	PHASE			CCT. NO.	LOAD PER PHASE			BRKR. SIZE	LOAD DESCRIPTION				
		A	B	C		A	B	C		A	B	C						
RECEPTACLES ROOM 205	15A	1.2			1				2	0.5		15A	EXIT SIGNS					
RECEPTACLES ROOM 205	15A		1.2		3				4	1.6		20A	EMERGENCY LIGHTS					
RECEPTACLES ROOMS 202, 205	15A			1.2	5				6		1.6	20A	LIGHTS RMS 205, 226, 227					
RECEPTACLES ROOM 202	15A	1.2			7				8	1.6		20A	LIGHTS RM 205					
RECEPTACLES ROOM 218	15A		1.2		9				10	1.6		20A	LIGHTS RMS 201, 202					
RECEPTACLES ROOM 224	15A			1.2	11				12		1.6	20A	LIGHTS RM 225					
RECEPTACLES ROOM 224	15A	1.2			13				14	1.4		15A	RECEPTACLES ROOM 224					
RECEPTACLES ROOM 224	15A		1.2		15				16	1.4		15A	FURNITURE MOUNTED RECEPTACLES ROOM 205					
RECEPTACLES ROOM 205	15A			1.2	17				18		1.4	15A	FURNITURE MOUNTED RECEPTACLES ROOM 205					
RECEPTACLES ROOM 205	15A	1.2			19				20	--		15A	RECEPTACLES ROOM 202					
RECEPTACLES ROOM 205	15A		1.2		21				22	--		15A	RECEPTACLES ROOM 202					
	15A				23				24	--		15A						
SCREEN ROOM 205	20A	--			25				26	--		15A	RECEPTACLES ROOM 224					
SCREEN ROOM 205	20A	--			27				28	--		15A	RECEPTACLES ROOM 224					
	15A	--			29				30	--		15A	RECEPTACLES ROOM 224					
	15A	--			31				32	--		15A	RECEPTACLES ROOM 224					
	15A	--			33				34	--		15A						
	15A	--			35				36	--		15A						
	15A	--			37				38	--		15A						
	15A	--			39				40	--		15A						
	15A	--			41				42	--		15A						
SUB-TOTAL KW													SUB-TOTAL KW					
TOTAL PER PHASE (KW)										PHASE A = -- KW PHASE B = -- KW PHASE C = -- KW			-- KW CONNECTED					
SURFACE MOUNTED <input type="checkbox"/>										FLUSH MOUNTED <input type="checkbox"/>			COLUMN MOUNTED <input type="checkbox"/>			* DENOTES HANDLE LOCKING DEVICE		

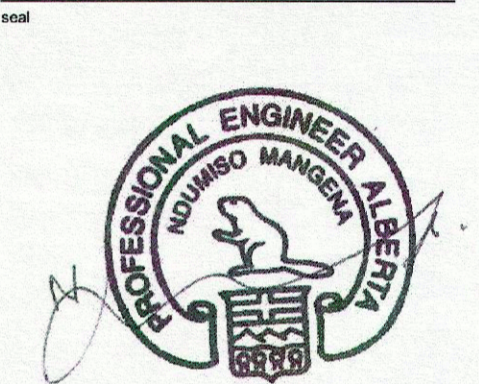

APPEGA PERMIT NUMBER: 113456
DATE: September 19, 2012


HIDI RAE
CONSULTING ENGINEERS INC.
Southcentre Executive Tower
11012 MacLeod Trail S. Ste. 240
Calgary, Alberta T2J 6A5
T. 403.271.0100
F. 403.271.0122

MECHANICAL - ELECTRICAL - COMMUNICATIONS

Group2
architecture
engineering
Group2 Architecture Engineering Ltd.

Head Office: 403.240.2329
Calgary Office: 403.271.2511
Edmonton Office: 780.447.9990
E: general@group2.ab.ca
www.group2.ab.ca

PROJECT TITLE
**DRUMHELLER TOWN
HALL RELOCATION**

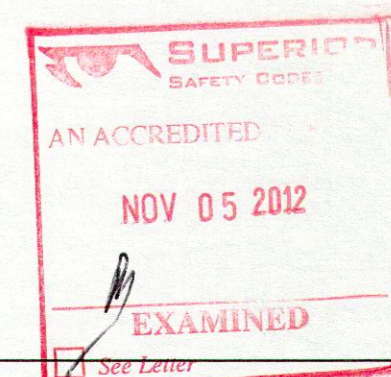

DRAWING TITLE
PANEL SCHEDULES
SECOND FLOOR

CHECKED | DRAWN | DATE
NM | FL | 12/06/28

12034 | E0.04 |
FILE | DRAWING