

REVISIONS



NO.	DATE	REVISION	BY
1	12.06.10	ISSUED FOR BP/TENDER	NM

ELECTRICAL GENERAL NOTES:

1. CONTRACTOR TO COORDINATE WITH SECURITY CONTRACTOR.
2. SECURITY EQUIPMENT TO BE ROUGHED IN.
3. ALL EMPTY CONDUIT TO BE PROVIDED WITH PULLSTRING.

SECURITY KEYNOTES:

1. CONTRACTOR TO ROUGH-IN JUNCTION BOX AND CONDUIT WITH PULLSTRING FOR FUTURE SECURITY DOOR DEVICES
2. LOCATED IN DESK/ MILLWORK
3. PROVIDE 27mm CONDUIT TO SERVER ROOM 114 FROM CAMERA LOCATION
4. RELAY ON DOORS FOR TIME LOCKS

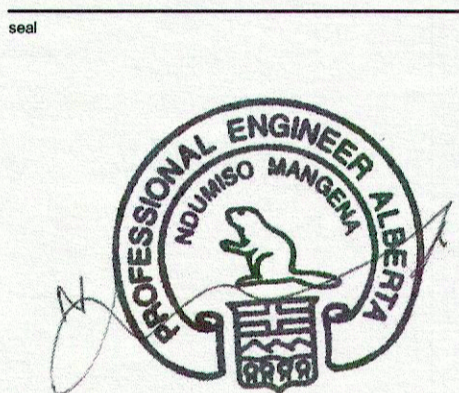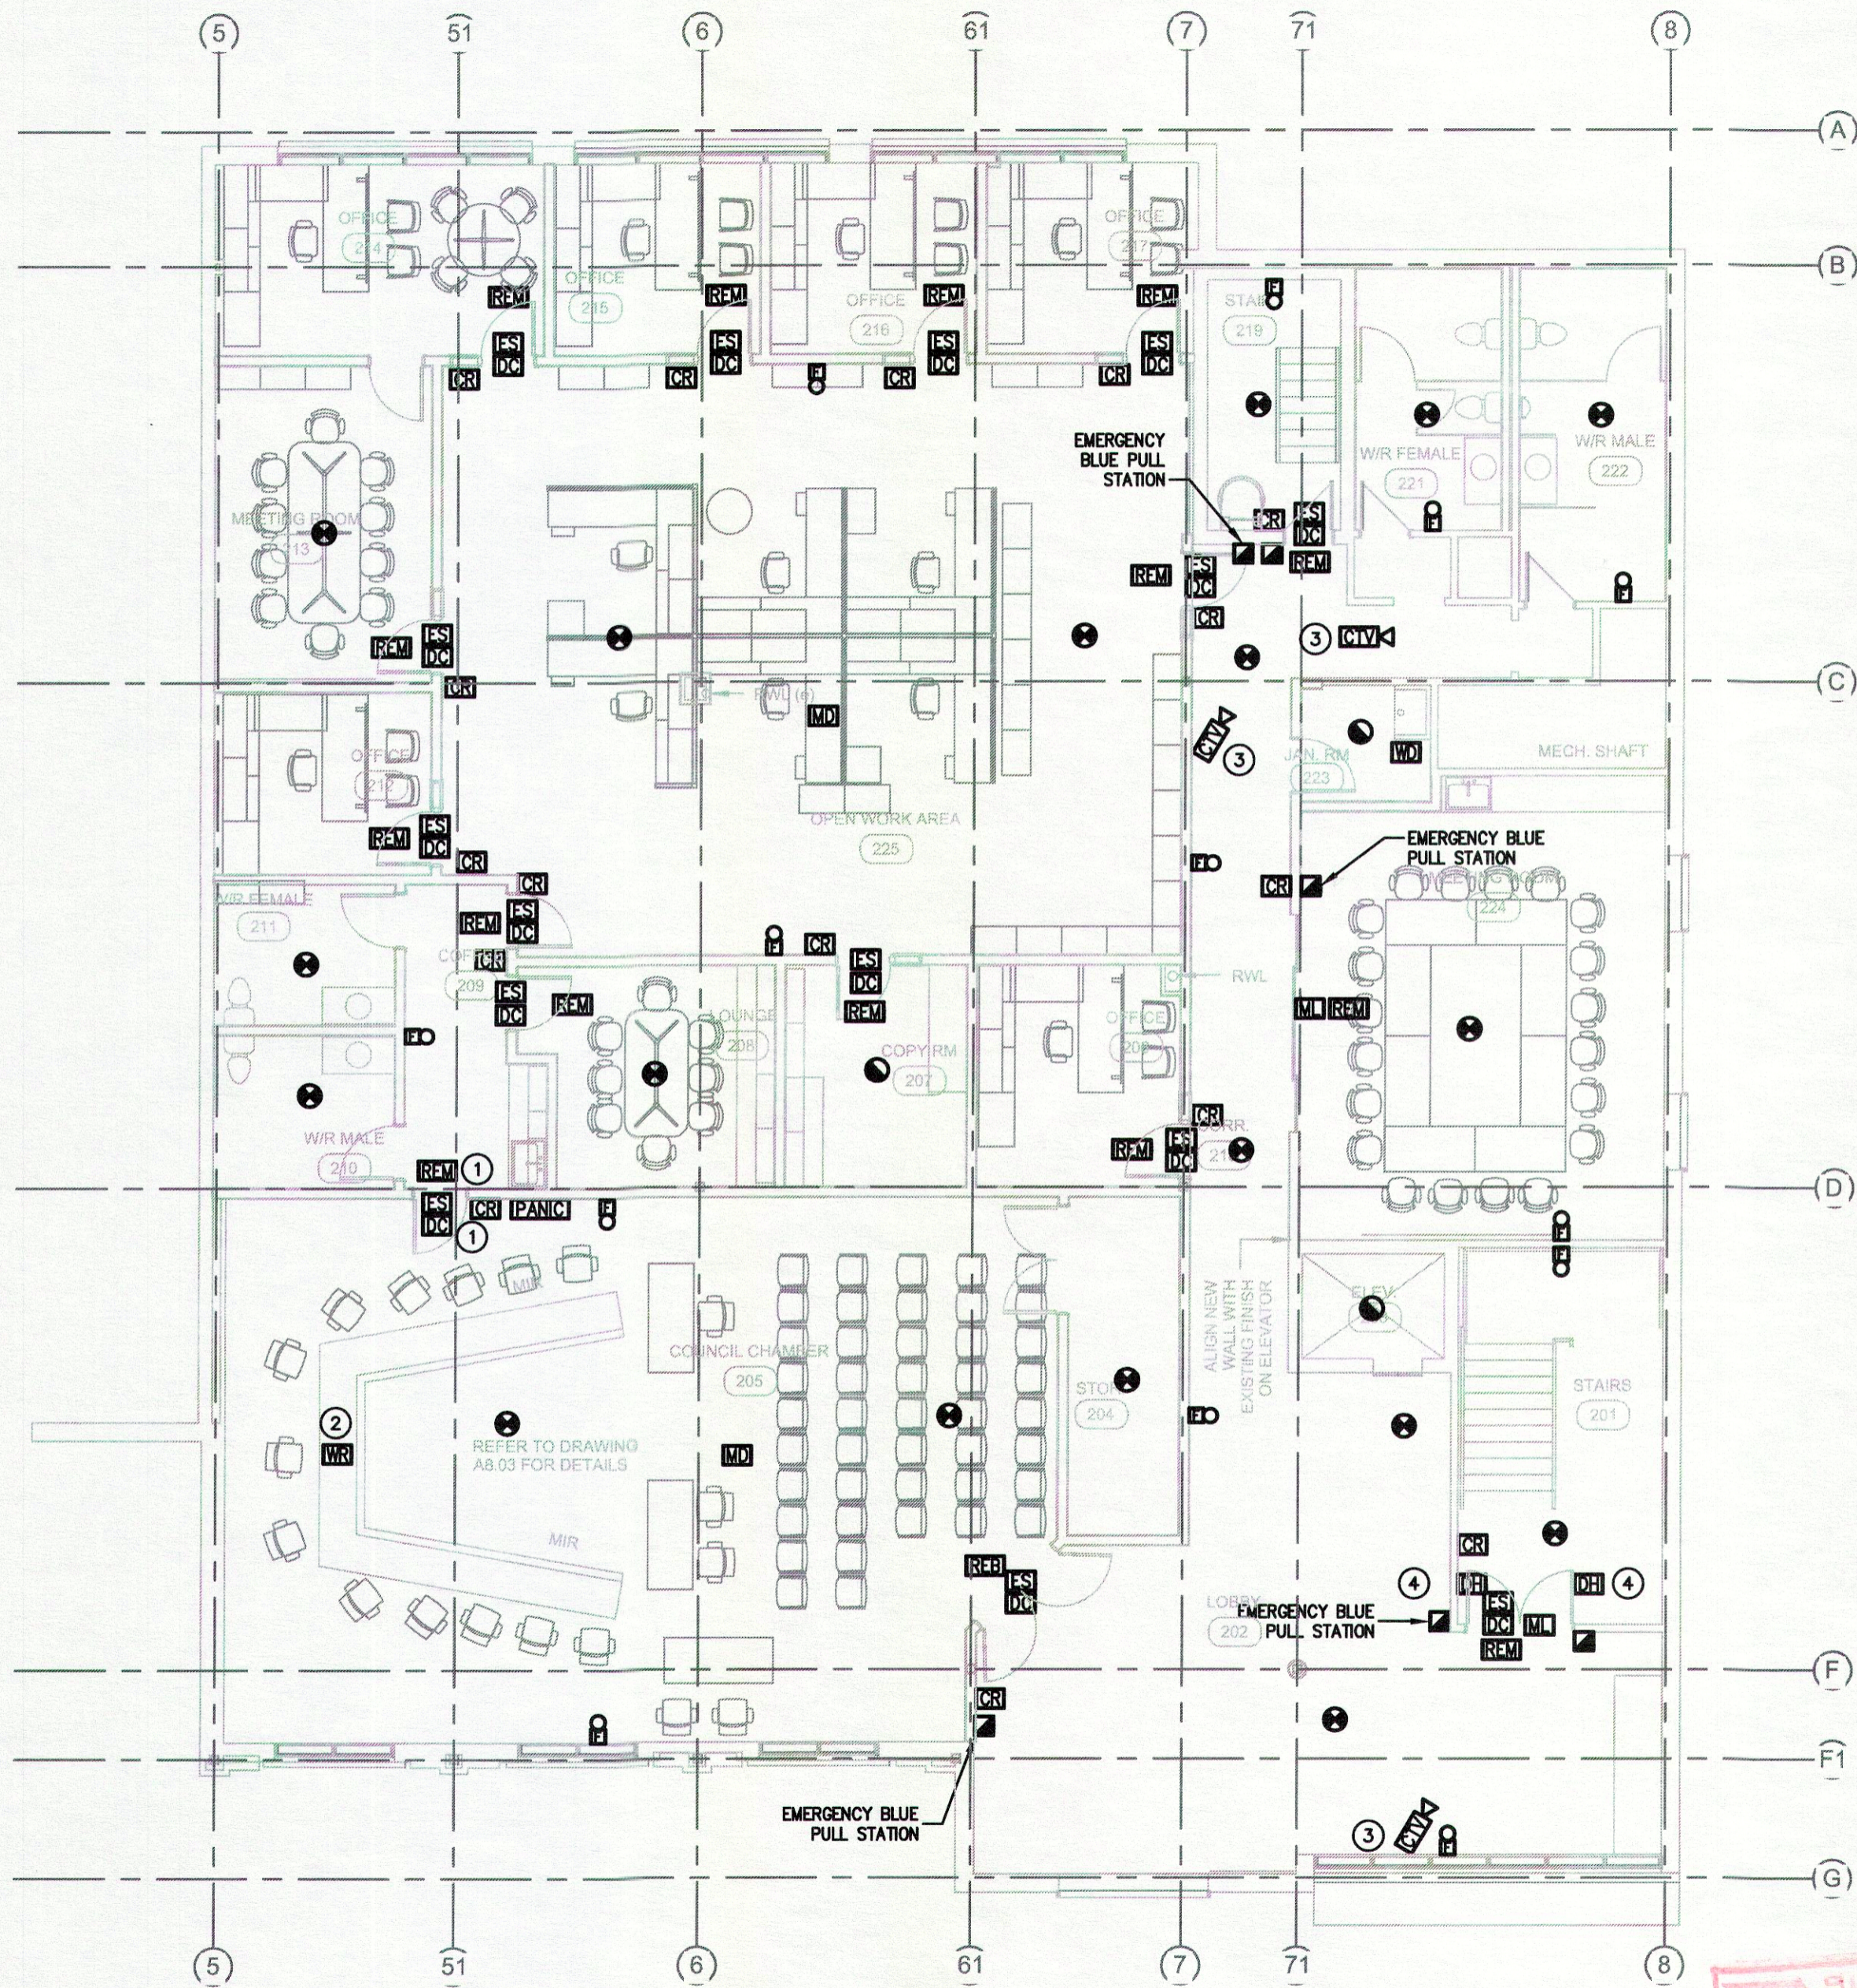

APPEGA PERMIT NUMBER: 113456
DATE: September 19, 2012

HIDI RAE CONSULTING ENGINEERS INC.
Southcentre Executive Tower
11012 Woodland Trail S., Ste. 240
Calgary, Alberta T2J 6A5
T. 403.271.0100
F. 403.271.9122


MECHANICAL - ELECTRICAL - COMMUNICATIONS

Group2
architecture
engineering
Group2 Architecture Engineering Ltd.

Calgary Office: T. 403.249.2200
Edmonton Office: T. 780.442.2999
E. general@group2.ab.ca
www.group2.ab.ca

PROJECT TITLE
DRUMHELLER TOWN HALL RELOCATION

DRAWING TITLE
SECOND FLOOR - SECURITY AND FIRE ALARM PLAN

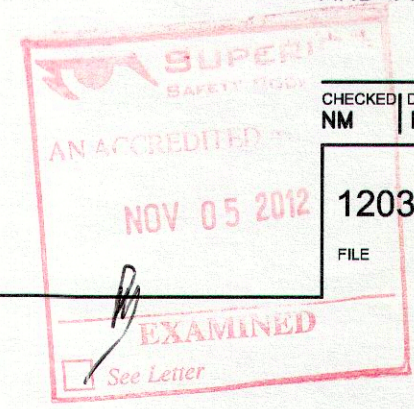

CHECKED	DRAWN	DATE
NM	FL	12/06/28

12034 | E3.02
FILE | DRAWING